



NIGERIA ELECTRICITY MARKET INTELLIGENCE REPORT

Q1 2020



DISCLAIMER	4
GLOSSARY OF TERMS	5
DEFINITION OF TERMS	6
SYNOPSIS	7
EXECUTIVE SUMMARY	8
BACKGROUND	9
1.0 GENERATION	10
1.1. GAS SUPPLY FOR POWER GENERATION.....	13
1.2. PEAK DEMAND FORECAST	13
1.3. PEAK POWER GENERATION	14
1.4. GENERATION CONSTRAINTS	14
1.5. EVACUATED POWER	15
1.6. OPERATIONAL PERFORMANCE	15
2.0 TRANSMISSION	17
2.1. WHEELING CAPACITY.....	20
2.2. GRID COLLAPSES	20
2.3. TRANSMISSION LOSSES	21
2.4. OPERATIONAL PERFORMANCE	22
3.0 DISTRIBUTION	24
3.1. ENERGY RECEIVED	25
3.2. DISTRIBUTION LOSSES	26
3.2.1. TECHNICAL AND COMMERCIAL LOSSES	27
3.2.2. COLLECTION LOSSES.....	28
3.3. OPERATIONAL PERFORMANCE	29
4.0 APPENDICES	31
4.1. GENERATION DATA.....	32
4.2. DISTRIBUTION DATA.....	38
ACKNOWLEDGEMENT	39



The killer app that got the world ready for appliances was the light bulb. So, the light bulb is what wired the world. And they weren't thinking about appliances when they wired the world. They were putting lighting into the home.

Jeff Bezos

Disclaimer

This publication presents information on the Nigerian Electricity Market. All reasonable precautions have been taken by Nextier Power to verify the reliability of the material in this publication. Its content reflects an analysis and trend of activities that characterise the market for the period under review. Although Nextier Power endeavours to ensure the accuracy of the information in this report, it cannot guarantee its 100 percent accuracy, nor can it be held liable for errors that may be contained therein. Users are to note that use of any information herein is purely at their discretion.



Glossary of Terms

AEDC	Abuja Electricity Distribution Company
ANED	Association of Nigerian Electricity Distributors
ATC	Aggregate Technical and Commercial
ATC&C	Aggregate Technical, Commercial and Collection
BEDC	Benin Electricity Distribution Company
BPE	Bureau for Public Enterprise
DisCos	Distribution Companies
EEDC	Enugu Electricity Distribution Company
EKEDC	Eko Electricity Distribution Company Plc
FGN	Federal Government of Nigeria
FMPWH	Federal Ministry of Power, Works and Housing
GenCos	Generating Companies
GWh	Gigawatt-hour
IBEDC	Ibadan Electricity Distribution Company
IE	Ikeja Electric
JEDC	Jos Electricity Distribution Company
KED	Kaduna Electricity Distribution Plc
KEDCO	Kano Electricity Distribution Company
kW	Kilowatts
MHI	Manitoba Hydro International
MAP	Meter Asset Provider
MMSCFD	Million Standard Cubic Feet per Day
MW	Megawatts
MWh/h	Megawatt-hours per hour
NERC	Nigerian Electricity Regulatory Commission
NESI	Nigerian Electricity Supply Industry
NNPC	Nigerian National Petroleum Corporation
NSO	Nigeria System Operator
ONEM	Operator of the Nigeria Electricity Market
PHED	Port Harcourt Electricity Distribution Company
ROW	Right-of-Way
SCADA	Supervisory Control and Data Acquisition
TCN	Transmission Company of Nigeria
TLF	Transmission Loss Factor
TSP	Transmission Service Provider


Definition of Terms

ATC&C Losses	The difference between the amount of electricity received by a Distribution Company from the Transmission Company and the amount of electricity for which it invoices its customers plus the adjusted collection losses.
Evacuated Power	This is the amount of generated electricity that is dispatched (or sent out) from the power plant to the transmission grid for supply to the distribution companies.
Generation Constraints	The amount of electricity that cannot be generated and evacuated from the power plant to the transmission grid (for supply to the distribution companies) due to challenges such as gas shortages, grid unreliability, distribution limitations and poor water management.
Grid Evacuation Efficiency	A measure of the evacuation efficiency as it relates to the supply of electricity from the generation-transmission interface to the transmission-distribution interface.
Installed Generation Capacity	This is the maximum electricity generation capacity that a power plant is designed to operate at. It is also known as nameplate capacity, rated capacity, or nominal capacity of a power plant. It is the intended full-load sustained output of a facility.
Operational Performance	Operational Performance, in this context, is the recorded percentage of the installed generation capacity that is utilised for electricity evacuation, transmission and distribution. It is a measure of the performance of the generation, transmission and distribution assets.
Peak Demand	Peak (or maximum) demand refers to the times of day when electricity consumption is at its highest.
Peak Power Generation	The maximum amount of electricity generated within a short time in a definite period (typically 24 hours).
Peak Demand Forecast	The estimated maximum electricity demand over a specified period (hourly, daily, monthly, seasonal and yearly cycles).
Wheeling Capacity	The operational capacity of the grid (including lines, substations and transformers) in the process of transmitting electricity to the distribution companies.



Synopsis

The data presented below is for Q1 2020 with Q4 2019 as the baseline used in the comparison.

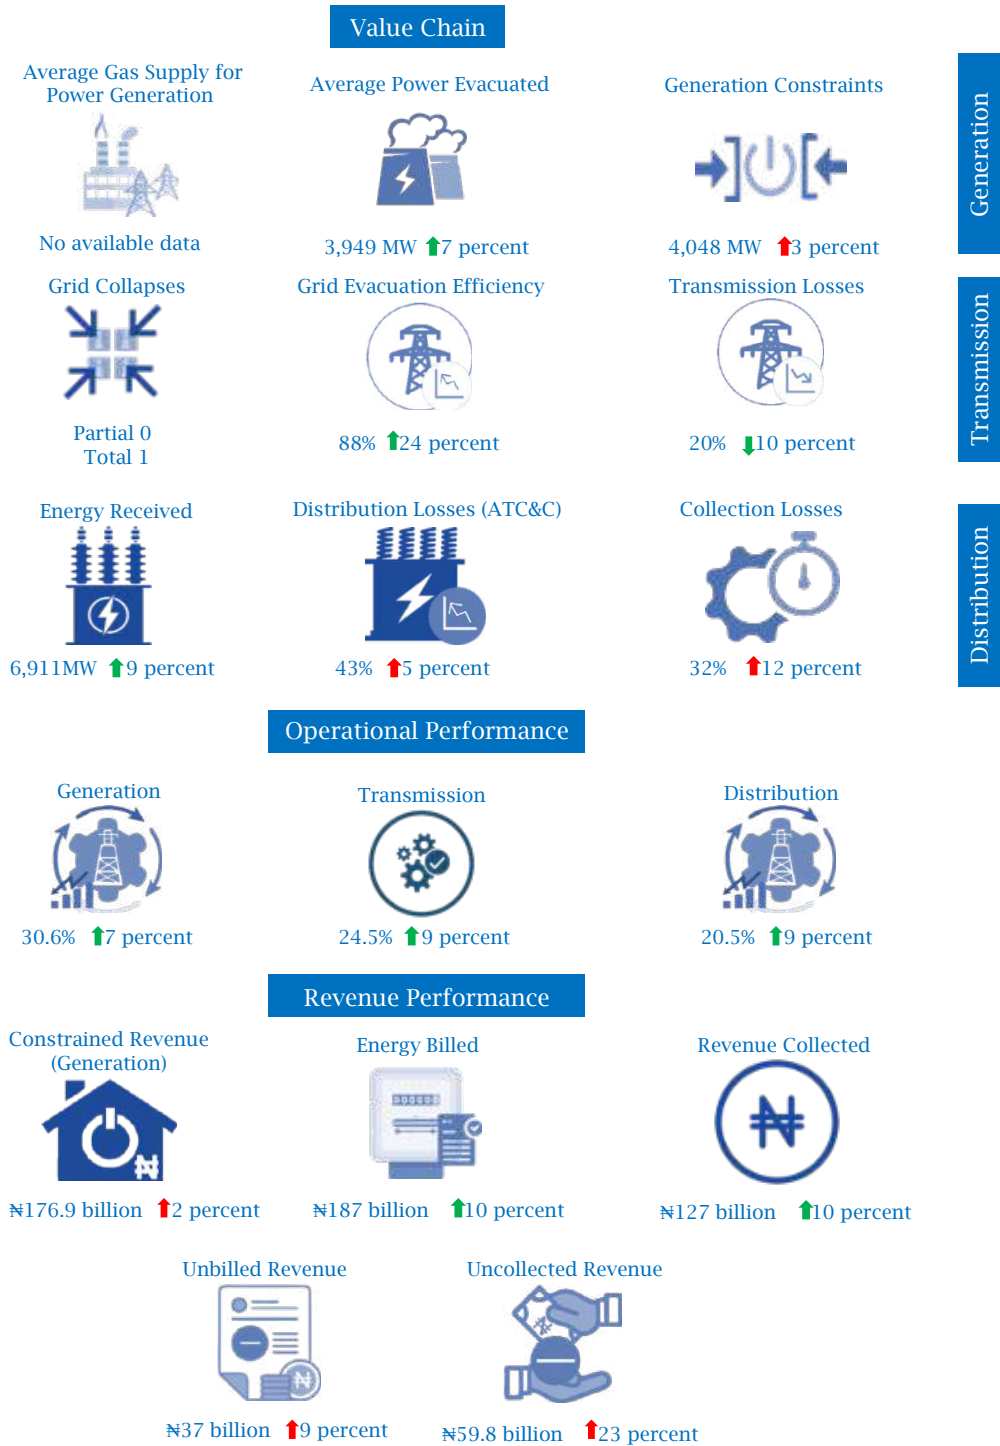

Executive Summary

This publication presents an analysis of the quarterly performance of Nigeria's Electricity Market, highlighting the generation, transmission, and distribution segments. Data was open-sourced from the Advisory Power Team (APT) and National Control Centre¹ (NCC) and analysed by Nextier Power.

Better market performance can be achieved through sector coordination and synchronised improvement of various factors. Some of these factors include adequate alignment of the gas suppliers and power generation; expanded, efficient and reliable transmission network; expanded distribution network capacities; proper water storage infrastructures; fair and bankable management of power dispatch; among many others. These proposed solutions are at a high level; therefore, it is fundamental to present a proper in-depth analysis that investigates and identifies the root causes of these issues across several interfaces in the value chain.

An analysis approach, in subsequent reports, will be to categorise several performance parameters based on the performance issues, identified causes, and potential solutions. This exercise will enable the development of trends and provide reasons for any identified changes between successive months and/or quarters. For instance, a hike in the gas constraints could indicate

unavailability of gas turbines. Still, the reasons why the turbines were not available would require a more in-depth analysis of available performance data. The reasons could be low gas supply levels, vandalised pipelines, challenges with circulating water pumps, high turbine exhaust temperature, and many others.

For the period under review (Q1 2020), about 30.6 percent of the installed generation capacity was utilised and the generated electricity evacuated to the national grid. Factoring transmission and distribution losses, only about 20.5 percent of the electricity were supplied to the end-users.

These inefficiencies mean that only about 3,949 MW of the installed capacity was dispatched to the grid. Of this amount, only 3,164 MW of electricity was transmitted and 2,641 MW of electricity was distributed and billed to electricity consumers. The distributed electricity was about one-tenth of the peak demand.

The recorded Aggregate Technical, Commercial and Collection (ATC&C) losses were 43 percent and collection losses were about 32 percent. The electricity market lost a combined revenue of about ₦274 billion during the period. These losses were mainly a result of the generation constraints, unbilled revenue to consumers and uncollected revenue from consumers.

¹ National Control Centre (NCC), "Daily Operational Report", Transmission Company of Nigeria (Performance Data Sourced: Peak Demand

Forecast, Spinning Reserve, Wheeling Capacity and Grid Collapses).

Background

The expectation, with the privatisation of Nigeria's electricity supply industry in 2013, was that the industry would attract private investment, increase electricity generation and supply, improve efficiency, etc. This has not been the case mainly because the eventual owners lack the technical and financial capabilities required to transform the industry. Similarly, the government has failed to deliver on its promises of cost-reflective tariffs and other policy and regulatory requirements. As a result, Nigeria's electricity market has been unable to provide an incremental, stable and uninterrupted power supply. The industry has also lacked coordination and communication among the market operators.

The current state of the market is not sustainable and manifests in accumulated market debt. The debt is driven mainly by the failure of the Distribution Companies (DisCos) to remit collections back up the value chain. In the period under review, DisCos, on average, paid about 30 percent of their electricity invoices to the Nigeria Bulk Electricity Trader (NBET). This has created an adverse chain reaction where the Generation Companies (GenCos) are unable to pay their invoices to the gas suppliers and the Transmission Company of Nigeria (TCN) is unable to maintain or expand its network.

There are a myriad performance and operational issues with generation, transmission and distribution:

- Generation capacity issues where the operational capacity of the

country's power plants is about one-third of the installed capacity.

- Gas supply issues resulting from incessant vandalisation of oil and gas pipelines which, in turn, results in gas shortages at power plants.
- Infrastructure issues resulting in frequent system collapses and restrictions within the transmission and distribution networks.
- Financial issues resulting in high ATC&C losses impact the financial viability of the DisCOs.

An independent market analysis will point to the root causes of the challenges across the entire value chain and highlight the areas of intervention. The analysis will include the compilation, validation, interpretation and dissemination of comprehensive technical data on the performance and operations of the electricity market.

The intent is to create a single source of standardised market data to provide confidence between market stakeholders and provide pragmatic options for resolving performance and operational challenges. This Nextier Power Nigeria Electricity Market Intelligence Report aims to not only ensure improved and sustainable practices for the operators in the electricity market but also build a robust stakeholder network in the electricity market.



1.0 Generation

In Nigeria, electricity generation supplied to the transmission grid comes predominately from two primary sources of energy: water and gas. These energy sources are converted to electricity through turbines installed either in the hydropower plant or in a gas power plant.

Since 2015, Nigeria’s installed generation capacity has increased by 4 percent from about 12,522 megawatts² (MW) to about 13,000 MW³. However, the generation sub-sector is still challenged by a myriad of issues, mainly gas supply, generation levels, dispatch operations, etc.

Other related challenges include pipeline vandalisation and its impact on gas availability for power generation, seasonal unavailability of water for hydropower generation plants, as well as inadequate transmission and distribution capacities. These combined challenges have resulted in a drop in expected generation capacity to about 7,000 MW.

In a broader context, most of the installed generation capacity is not supplied to the end-user due to grid and distribution constraints. The current operational generation capacity is about one-third of the installed capacity at 3,679 MW.

The government, in an effort to improve electricity supply across the country, has implemented various policies and regulations to restructure the electricity market. The strategic plan is also expected to engender fairness, encourage competition and promote market coordination and participation.

The Eligible Customer Regulation, which was issued in November 2017, is one of these regulations. The regulation provides an opportunity to resolve the irregular and unreliable supply to electricity consumers by enabling direct trade between GenCos and qualified customers under a willing buyer-willing seller transaction model.

Installed Capacity



12,910 MW ↔

Average Power Evacuated



3,949 MW ↑7 percent

Peak Power Generation




5,268 MW ↑2 percent

Operational Performance



30.6% ↑7 percent

Average Gas Constraints




3,288 MW ↑49 percent

² The Advisory Power Team, Office of the Vice President, “Nigeria Power Baseline Report,” Power Africa, 2015.

³ For the period under review, the total installed capacity (including both grid-connected and unconnected capacities) remains at about 12,910 MW. Thermal power plants (gas and steam) accounted for about 11,020 MW (85 percent) of the total installed capacity. Hydropower plants accounted for about 1,890 MW (15 percent) of the total installed capacity.

Average Grid Constraints



567 MW ↓65 percent

Average Water Constraints



70 MW

Constrained Revenue



₦176.9 billion ↑2 percent

Average Gas Supply for Power Generation



No available data

MMSCFD to MW Conversion



N/A

Peak Demand Forecast



25,790 MW ↔

Three GenCos are currently implementing the Eligible Customer Regulation under bilateral agreements with eligible customers. The companies include Paras Energy/ Communauté Electrique du Bénin (CEB); Egbin/ Ikeja Distribution Company; and Mainstream Energy (Kainji and Jebba)/ Xing 1 and Xing 2, Inner Galaxy, KAM Steel 2, Kam Integrated, KAM Steel Line 1, Ashaka Cement, Olam Flour Mills, and Lordsmith⁴.

The intent is that, over the long run, unserved⁵ and underserved⁶ customers can purchase power directly from the GenCos. This will also lead to a fast-tracking of the

transition from vesting contracts to bilateral contracts⁷.

However, the regulation is widely considered to be progressing at a slow pace. Perhaps, the market is not in an ideal condition for a successful implementation of this regulation. In an ideal electricity market, the electricity supply should match or exceed the electricity demand. Currently, the Nigeria Electricity Market does not meet this requirement.

This chapter presents an analysis of several performance parameters related to electricity generation. The parameters include Evacuated Power, Peak Power Generation, Peak Demand Forecast, Generation

⁴ Four of these Eligible Customers that applied in July 2018 are still operating without permits.

⁵ An area within a distribution network without an existing distribution system.

⁶ An area within a distribution network with an existing but poorly supplied or non-functional distribution system.

⁷ Vesting contracts are regulatory instruments that mitigate the GenCos from exercising their market powers. It mandates a specified amount of electricity to be hedged at a specified price. Vesting contracts promote efficiency and competition in the electricity market for the benefit of consumers. Bilateral contracts are binding agreements between two licensed operators in the market. These contracts are signed to ensure that agreements are clear and legally enforceable. The main reason for the parties to sign these contracts is to hedge the electricity price (both from the supply and the demand side), and also, to ensure that supply meets demand in the event of power shortages. Currently, NBET is positioned to buy electricity in bulk from the generating companies (through Power Purchase Agreements) and sell (through vesting contracts) to the distribution companies. In advanced stages of the Nigerian Electricity Market, bilateral contracts will be signed between the GenCos and the DisCos. This will phase out NBET's position in the market.

Constraints, Gas Supply for Power Generation and Operational Performance. The period under review is Q1 2020 with Q4 2019 is used as a baseline for comparison.

1.1. Gas Supply for Power Generation

Gas supply shortages have been one of the foremost challenges with electricity generation in Nigeria. The country has insufficient regulatory and policy frameworks and commitments to ensure alignment of the gas and power generation sectors.

For the period under review, gas-fired power plants accounted for about 85 percent of the total installed generation capacity in the country.

and distribution to align with the demands of the power sector. For the period under review, there was no available data on the average volume of gas supplied by the Nigerian National Petroleum Corporation (NNPC) to thermal power plants.

1.2. Peak Demand Forecast

Peak demand forecasts are needed for generation and network expansion planning, tariff evaluations, operations and dispatch management, etc.

The peak demand forecast comprises of both the estimated connected loads⁸ and the suppressed⁹ loads.

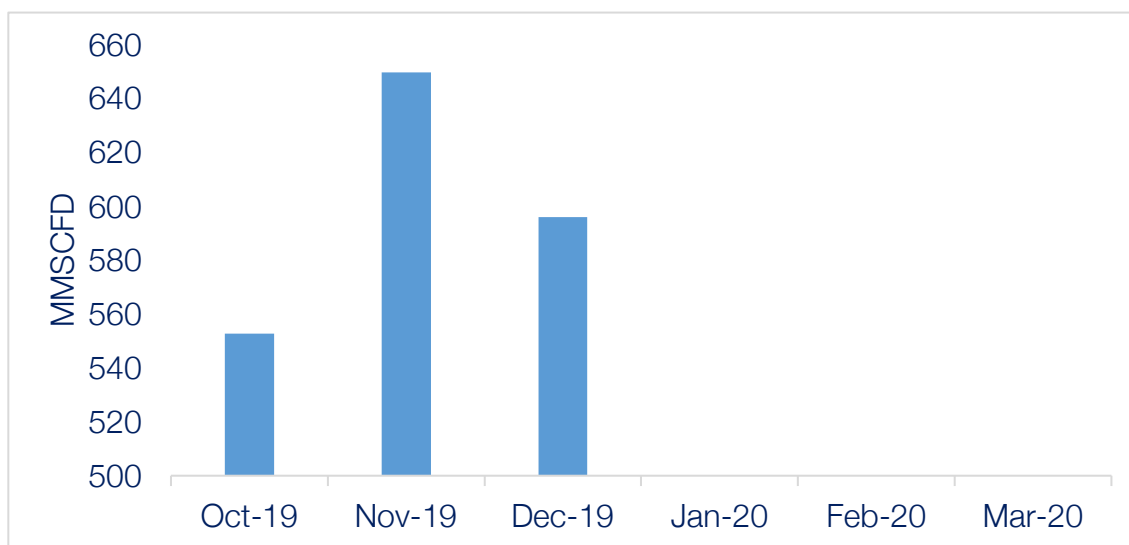


Figure 1: Average Gas Supply for Power Generation between October 2019 and March 2020. There was no available data from January 2020 to March 2020.

With such an overreliance on gas, there is a need to implement provisions that would enable well-timed and effective gas production

The monthly end-user approach estimates future trends from historical data and factors in indicators such as population

⁸ Connected load is the sum of ratings of all electrical equipment that are connected at the supply point (distribution feeders) regardless of their operational status. The calculation does not measure or test for their actual demand.

The connected load, which is independent of time, is greater than the peak load demand. ⁹ Suppressed load is the electricity that fails to get to the distribution companies due to unavailable infrastructures. The consumers' demands are also suppressed by this event.

growth, installed generation capacity, installed transmission substation and transformers, wheeling capacity, installed distribution feeders, daily electricity consumption, and others.

For the period under review, the average peak demand forecast remained at about 25,790 MW.

1.3. Peak Power Generation

Peak power generation is the maximum amount of electricity that is generated within a short time in a defined period of operation.

Data from the Daily Operational Report provided by the National Control Centre (NCC) indicate that peak power generation is normally recorded over eight hours.

For the period under review (Q1 2020), Nigeria recorded the highest peak generation of 5,268 MW in February 2019. This was a 2 percent rise from Q4 2019 (5,157 MW in November 2019). Since there was no available data on gas supply, it could not be determined if there was any correlation between the rise in peak generation and the average volume of gas supply between November and February.

1.4. Generation Constraints

Generation constraints are mainly caused by grid unreliability, distribution limitations, gas shortages and poor water management.

For the period under review, the total average constraints recorded was about 4,048 MW. This was a 3 percent increase from Q4 2019 (3,927 MW).

In Q1 2020, an average of 3,288 MW could not be generated due to the unavailability of gas. In comparison to Q4 2019 (2,202 MW), gas constraints increased by 49 percent. The reason for the increase could be partly attributed to the decline in the volume of gas supply during the period. However, this cannot be verified with available data. Another possible reason for the increase could be from increased outages and vandalism of gas supply assets, as well as frequent repairs and maintenances during the period.

Similarly, an average of about 70 MW could not be generated by the hydro-power plants due to poor water management. There were no water constraints recorded in Q4 2019.

Grid constraints¹⁰ result from the unavailability of transmission and distribution network infrastructures. In Q1 2020, average grid constraints were 567 MW, a 65 percent decline from the 1,635 MW recorded in Q4 2019. As a result of the constraints, grid evacuation efficiency¹¹ was about 88 percent in Q1 2020, a 24 percent rise from the 70 percent recorded in Q4 2019.

Accordingly, generation constraints were driven mainly by gas constraints (81.2 percent), grid

¹⁰ Due to frequency imbalance (in the transmission network) caused by changes in the distribution companies' load demand. Also, there are transmission line constraints during electricity evacuation caused by network

outages, collapses, and other infrastructural limitations.

¹¹ The evacuation performance of the generation-transmission interface.

constraints (14 percent), and water constraints (1.7 percent). The remaining 3 percent of the generation constraints were due to generation plant outages (including forced, planned, emergency and urgent outages) and scheduled repairs and maintenances.

These inefficiencies culminated in an estimated total revenue loss of ₦176.9 billion, a 2 percent rise from Q4 2019 (₦173.6 billion).

1.5. Evacuated Power

Evacuated power is the electricity that is generated and evacuated to the transmission grid and then dispatched to the Distribution Companies (DisCos). It is typically tracked and recorded daily.

For the period under review, the average power evacuated to the grid was about 3,949 MW. This was a 7 percent increase from Q4 2019 (3,679 MW).

The improvement could have been as a result of several performance parameters related to the generation-transmission interface, including the slight 2 percent rise in peak power generation, 65 percent

reduction in grid constraints and 24 percent increase in grid evacuation efficiency. Although the total gas constraints (caused mainly by low gas supply) increased by 49 percent during the period, this change did not have a significant impact on the evacuated power. This is because the grid constraints improved significantly within the same period.

1.6. Operational Performance

Operational performance is recorded as a percentage of the installed generation capacity. For the period under review, average operational performance (or utilisation factor)¹² for the generation segment was about 30.6 percent. This was a 7 percent improvement from the 28.5 percent recorded in Q4 2019. The increase can be squarely attributed to the 7 percent increase in power evacuated during the same period.

It also means that, on the average, only about 30.6 percent of the total installed generation capacity gets utilised and the electricity evacuated to the national grid. Without the constraints, the expected operational performance would be just over 60 percent.

¹² The percentage of the nameplate capacity that is generated and dispatched daily to the national grid.

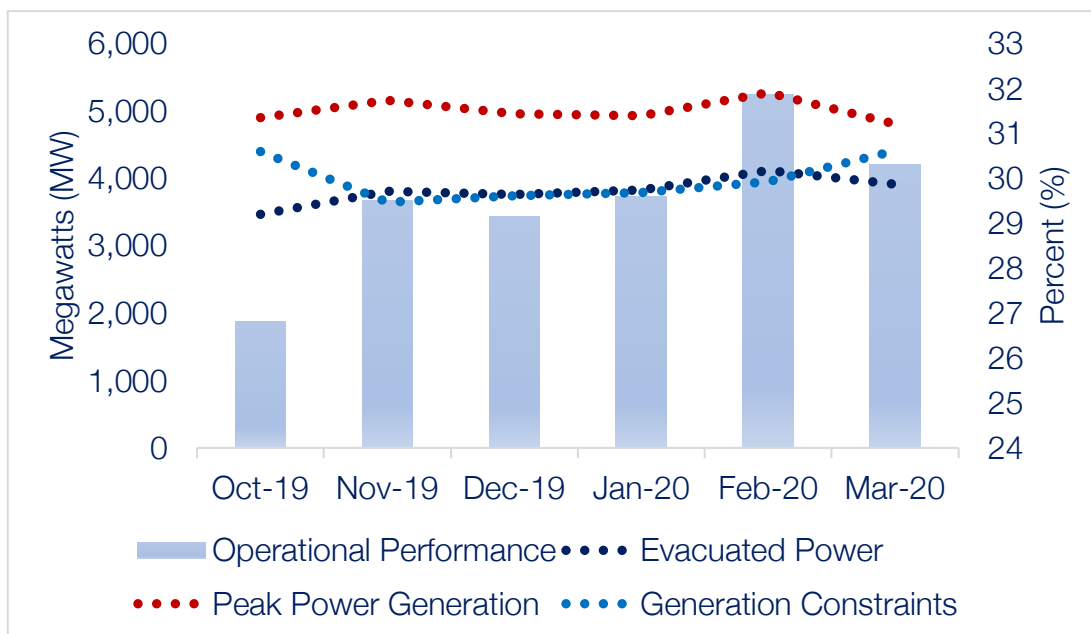


Figure 2: Operational Performance, Peak Power Generation, Evacuated Power and Generation Constraints between October 2019 and March 2020. The monthly average was recorded for the period under review.

Table 1: Generation Performance Data in Q4 2019 and Q1 2020. The monthly average was recorded for the period under review. (* - There was no available data from January 2020 to March 2020)

Period	Q4 2019			Q1 2020		
	October	November	December	January	February	March
Evacuated Power (MW)	3,464	3,809	3,763	3,821	4,114	3,912
Peak Power Generation (MW)	4,894	5,157	4,952	4,931	5,268	4,804
Peak Demand Forecast (MW)	25,790	25,790	25,790	25,790	25,790	25,790
Generation Constraints (MW)	4,395.96	3,643.78	3,742.24	3,790.86	3,948.54	4,405.61
Gas Supply for Power Generation (MMSCFD)	552.64	649.84	596 ¹³	*	*	*
Operational Performance (percent)	26.83	29.50	29.15	30	32	30

¹³ Source: NNPC Monthly Financial and Operations Report December 2019



2.0 Transmission

The transmission segment of Nigeria’s electricity industry is responsible for supplying electricity through the national transmission grid to the distribution companies (DisCos). The segment is often regarded as the "middleman" between generation and distribution in the electricity value chain.

Nigeria’s national transmission grid is owned and managed by the Transmission Company of Nigeria (TCN). Despite TCN being fully government-owned, it is also a licensed operator in Nigeria’s electricity market. TCN’s core functions consist of the Operator of the Nigeria Electricity Market (ONEM)¹⁴, Nigeria System Operator (NSO)¹⁵ and the Transmission Service Provider (TSP)¹⁶.

Here’s some context. The Government of Nigeria retained ownership of the Transmission Company of Nigeria during the unbundling and subsequent privatisation of the electricity supply industry. The reasons adduced for this structure was the need to protect national security, and also, to avoid creating a natural monopoly. This strategic decision was also informed by the significant financial requirements for maintaining and expanding the grid infrastructure, Right-of-Way (ROW) settlements, among others.


As part of the reform process, TCN was to be managed under concession. Manitoba Hydro International (MHI) was selected as concessionaires to improve the operational efficiencies and overall performance of the company between 2012 and 2016¹⁷. In February 2017, a new leadership was installed at TCN following the failure of MHI to achieve any significant improvements. The new leadership has established a Transmission Rehabilitation and Expansion Programme (TREP).

Wheeling Capacity



8,100 MW ↔

Grid Collapses



Partial 0, Total 1

Grid Evacuation Efficiency



88% ↑24 percent

Transmission Losses



22% ↓10 percent

Operational Performance



24.5% ↑10 percent

¹⁴ The administrator of the electricity market. The ONEM is licensed to function as the Market Operator of the electricity market. ONEM is responsible for the operation and settlement arrangements in the market. It is also responsible for the administration of the metering and settlement system among GenCos, TCN, and DisCos.

¹⁵ The administrator of the national grid. The NSO is responsible for the planning, dispatch and operation of the transmission system, in addition to ensuring the security and reliability of the electricity network grid. It operates out of TCN but will become an independent organisation under the “Long-Term Stage” of the market.

¹⁶ The operators of the national grid. The TSP is responsible for developing network infrastructure through grid construction, operation and maintenance of the grid system, international connections, load forecasting, system expansion planning, among others.

¹⁷ A four-year management contract was initialled between the Federal Government of Nigeria (FGN) and Manitoba Hydro International (MHI). The objective of the contract was to provide technical and managerial expertise that will improve the operational efficiencies and overall performance of TCN. However, the contract ended on August 31, 2016, without achieving its objective. The FGN did not extend the contract any further.

The plan is to stabilise the grid for optimum performance, in line with international best practices. TREP is expected to expand the capacity of the grid to 20,000 MW by 2021. The four TREP milestones include system frequency control, adequate spinning reserve, functional Supervisory Control and Data Acquisition (SCADA)¹⁸, and a critical investment in lines and substations. The programme also includes plans to develop a competent and well-motivated workforce.

Expanding the infrastructure and improving the reliability of the grid is in line with the government's policy roadmap to achieve stable power supply. An improvement in the available generation capacity (just over 7,500 MW) nationwide has further equipped the government to deliver on this objective.

As such, several projects have been scheduled to be completed in the transmission sub-sector, including accomplishing the required frequency control, procuring fibre optic and Automated Meter Reading (AMR) technologies¹⁹, implementing SCADA and Energy Management Systems (EMS)²⁰ and expanding transmission networks.

Recently in August 2019, the Nigerian Electrification Roadmap (NER) initiative conceptualized after a meeting between President

Muhammadu Buhari and German Chancellor Angela Merkel. The initiative is intended to resolve existing challenges in the power sector and expand the capacity for future power needs.

By addressing problems at the transmission and distribution interfaces, the plan aims to have three phases:

- **Phase 1:** Increase the operational grid capacity from 5,000 MW to 7,000 MW
- **Phase 2:** Increase operational grid capacity from 7,000 MW to 11,000 MW
- **Phase 3:** Increase the operational grid capacity from 11,000 MW to 25,000 MW

The commercial terms are still being negotiated and the final proposal is expected to be agreed-on at a later date.

This chapter presents an analysis of several performance parameters related to the transmission segment. The parameters include Wheeling Capacity, Grid Collapses, Transmission Losses and Operational Performance. The period under review is Q1 2020 with Q4 2019 as baseline used for comparative analysis.

¹⁸ SCADA is an acronym for Supervisory Control and Data Acquisition. Simply put, SCADA is a computer system that monitors and controls a process or series of operations. SCADA systems are typically used to control geographically dispersed assets. These assets are often scattered over thousands of square kilometres. Concerning the supply of electricity, SCADA monitors substations, lines, transformers, and other transmission and distribution assets. It is an effective tool for system operations, as well as monitoring and grid management.

¹⁹ Automated meter reading (AMR) is a technology used in utility meters for collecting the data that's needed for billing purposes. It ensures that all energy is accurately metered, and every market participant has access to the data.

²⁰ Energy Management System (EMS) is a SCADA system without monitoring and control functions. More specifically, EMS refers to the collective suite of grid network applications, as well as the generation control and scheduling applications. Simply put, SCADA is the software and EMS is the hardware.

2.1. Wheeling Capacity

Wheeling capacity is the rated ability of a transmission network to supply energy to an electrical load outside its boundaries. It is a measure of how much energy can be supplied for distribution to the end-user. This measure is based on the capacity of transmission equipment, such as lines, substations, busbars²¹, transformers, etc.

The capacity of Nigeria's transmission network, including installed substations and transformers, is about 16,000 MW. The simulation for the wheeling capacity is, however, speculative. The simulation also includes the constraints of the transmission network. The wheeling capacity, at the end of March 2020, remained at about 8,100 MW.

In practice, Nigeria's national grid operates at a wheeling capacity close to 5,500 MW. The grid has also been unable to supply electricity to match its wheeling capacity. Regardless of the exact estimate, inadequate infrastructural and network capacities of the DisCos may be the leading reason why the grid has been unable to wheel electricity close to its capacity.

There are about 738 transmission interfaces with electricity distribution companies (DisCos). Of this number, 421 of these interfaces are completely protected. The remaining 317 interfaces are not protected. This

means that any fault or incidence will affect the substations or transformers owned by TCN.

Hence, there is a need for more injection substations at these interfaces to protect transmission equipment, and also, to optimise the wheeling capacity and electricity supply.

2.2. Grid Collapses

The national grid recorded 11 grid system collapses (10 total, and one partial collapse) in 2019. The total collapses occurred in January (four), February (one), April (one), May (one), June (one), August (one), and December (one). One partial collapse was recorded in November.

To resolve these collapses, TCN plans to implement a competitive procurement of Spinning Reserve.

The Spinning Reserve provides auxiliary electricity needed to stabilise the grid in the event of frequency imbalances that may lead to a system collapse. This procurement was in response to the directive²² from the Federal Ministry of Power, Works and Housing (FMPWH) to improve industry performance and coordination.

The Spinning Reserve of TCN (as recorded on the NCC daily operational report) is typically either 40 or zero MW. As of March 31, 2020, the recorded spinning reserve

coordination. The document titled "Power Sector Policy Directives and Timelines, June 2019" covered directives to sector stakeholders, including National Electricity Regulatory Commission (NERC), Nigerian Bulk Electricity Trader (NBET), Transmission Company of Nigeria (TCN) and Bureau of Public Enterprises (BPE). The document also addresses several issues centred on performance, collaboration, communications, capacity improvement, and many others.

²¹ A busbar is a strip of metal used to conduct electricity within an electrical substation, distribution board, electric switchboard or other electrical equipment. A busbar is usually a flat or hollow piece of copper, brass or aluminium. It allows heat to be released quickly because of its relatively large surface area.

²² The Federal Ministry of Power, in a bid to restructure the power sector, exercised policy directives towards improving industry

was zero MW. The spinning reserve should have been at least 395 MW (10% of the evacuated power – 3,949 MW).

The proposed amount of procured electricity is 295 MW, which still falls short of the required 368 MW. It is, however, progress towards achieving grid stability.

For the period under review, the total number of grid collapses recorded was one (1 collapse). It remained unchanged from Q4 2019 (1 collapse).

2.3. Transmission Losses

Transmission of electricity over long distances results in energy losses. Majority of these losses are from transmission lines, as well as substations that are situated at interfaces with the DisCos.

According to Nigerian Electricity Regulatory Commission (NERC), the Transmission Loss Factor (TLF) is “measured by the proportion of the difference between the total energy sent out by power stations and energy delivered to all DisCos by TCN relative to the total energy sent out”. However, this measurement does not include other recipients of electricity such as industrial and special customers²³, as well as the GenCos’ imported energy²⁴.

The TLF, intended for billing purposes, provides better accuracy

and authenticity, as it includes all recipients of electricity. This is because factors that make up these losses have been aggregated into the measurement. These factors relate to the electricity generated, electricity consumed by the GenCos, unbilled electricity, stolen electricity, non-payments, measurement errors in the transmission network, etc.

TCN continues to implement several loss-reduction measures that will expand and stabilise the grid. These proactive measures include line maintenance, completion of line and substation projects, administration of grid code and market rules, among others.

The average energy evacuated through the national grid to the Distribution Companies (DisCos) was 3,949 MW (see section 1.5). For the period under review, the total average energy received at the DisCos was 6,911 GWh (3,164 MW). This was a 9 percent increase from Q4 2019 (6,333 GWh, about 2,868 MW).

Consequently, the recorded transmission losses were about 20 percent. This was a 10 percent decline from Q4 2019 (22 percent). The logical reason for the decline was that, in comparison to Q4, more electricity was evacuated to the grid and more electricity was received by the DisCos.

²³ Industrial customers use premises for manufacturing goods, including welding and ironmongery (manufacture of iron goods such as steel). Special customers include customers such as agriculture and agro-allied industries, water boards, religious houses, government and teaching hospitals, government research institutes, and educational establishments. Some of these customers are supplied electricity from the 132kV and 330kV transmission network.

²⁴ Energy importing occurs when GenCos that are supposed to supply energy to the grid participate in receiving energy from the grid. Here, the GenCos are considered as DisCos or special customers in the market. This is to ensure accurate energy auditing and billing processes. Bi-directional meters can measure both the energy generated and received (from other GenCos) to the effect.

The transmission losses calculated in this report only includes the loss difference between electricity sent to the grid and electricity received by the DisCos (except Yola Distribution Company). It does not include other recipients of electricity such as industrial and special customers, as well as the GenCos' imported energy.

the transmission segment was about 24.5 percent. This was a 10 percent upturn from Q4 2019 (22.2 percent). The recorded upturn can be logically attributed to the 10 percent drop in transmission losses, as well as the 9 percent increase in electricity transmitted to the distribution companies during the same period.

2.4. Operational Performance

The operational performance is recorded as a percentage of the installed generation capacity (about 12,910 MW).

It also means that only about 24.5 percent of the total installed capacity gets transmitted to the distribution companies for consumption. Concerning the estimated wheeling capacity of 8,100 MW, the operational performance will be about 39 percent.

For the period under review, the average operational performance of

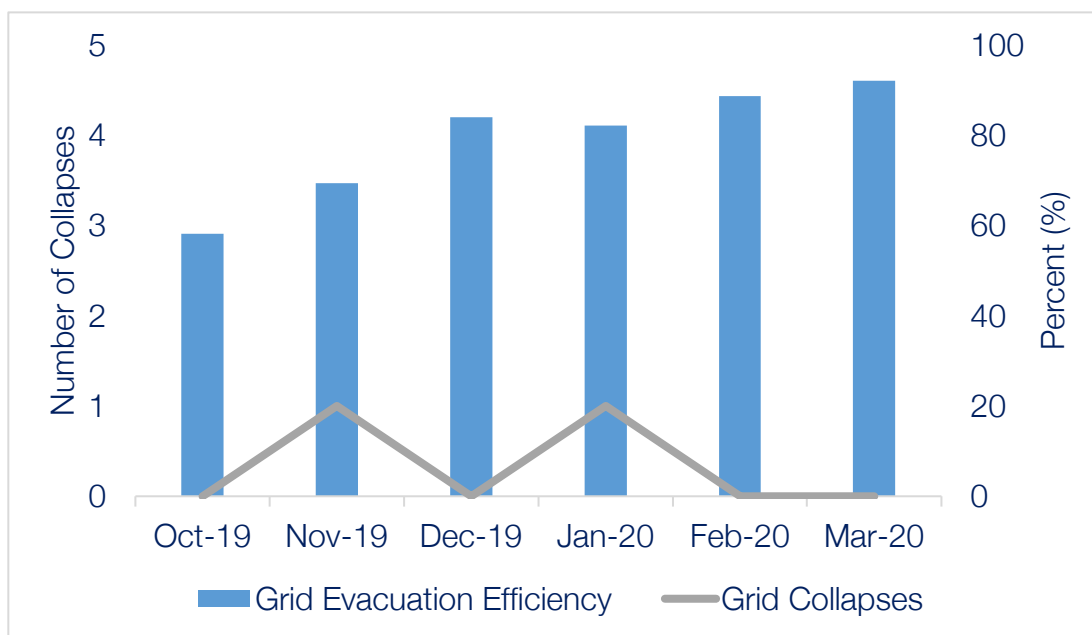


Figure 3: Average Grid Evacuation Efficiency and Total Number of Grid Collapses between October 2019 and March 2019.

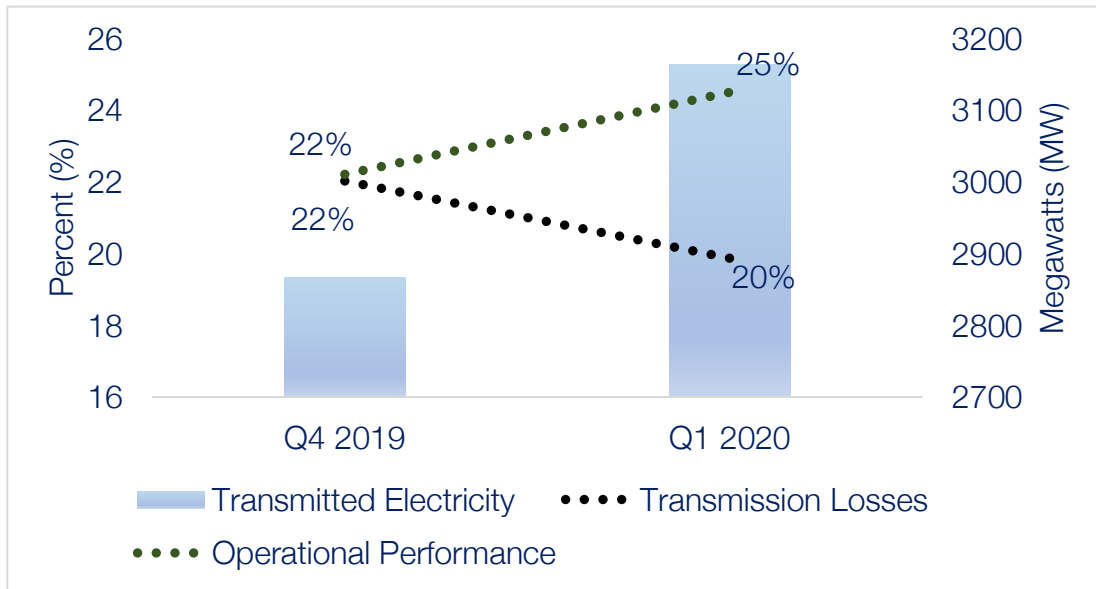


Figure 4: Transmitted Electricity, Transmission Losses and Operational Performance in Q4 2019 and Q1 2020. The quarterly average was recorded for the period under review.

Table 2: Transmission Performance Data in Q4 2019 and Q1 2020.

Period	Q4 2019			Q1 2020		
	October	November	December	January	February	March
Wheeling Capacity (MW)	8,100	8,100	8,100	8,100	8,100	8,100
Grid Collapses	0	1	0	1	0	0
Grid Evacuation Efficiency (percent)	58.11	69.28	83.95	82	89	92

Period	Q4 2019	Q1 2020
Losses (percent)	22.03	19.87
Transmitted Electricity (MW)	2,868.21	3,164.21
Operational Performance (percent)	22.22	24.51



3.0 Distribution

The distribution sub-sector is tasked with the responsibility of providing last-mile delivery of electricity to the consumer.

In the unbundling and subsequent privatisation of the electricity value-chain, the national distribution network was regionalised to eleven franchise areas. These areas are managed and operated by licensed distribution companies.

The privatised sub-sector is still faced with significant challenges related to distribution losses. Thus, there is a requirement for the DisCos to invest in the network system to meet performance and efficiency targets.

Recall that the privatisation of the distribution system assets was centred on the capability of prospective investors to reduce Aggregate Technical and Commercial Collection (ATC&C) losses in the distribution network. With Bureau for Public Enterprise (BPE) extending the performance agreement end date to December 2019 (December 2020 for Kaduna DisCo), the DisCos are on borrowed time to invest in network infrastructures and improve efficiency to specified targets.

Accordingly, a plan to expand the distribution network capacity will require loss reduction investments, engagement of Meter Asset Providers (MAP), completion of customer and asset enumeration, improved metering infrastructure and carrying out energy demand studies.

This chapter presents an evidence-based analysis of several performance parameters related to the distribution sub-sector. The parameters include Energy Received, Energy Billed, Revenue Collected, Distribution (Technical, Commercial and Collection) Losses and Operational Performance. The period under review is Q1 2020 with Q4 2019 as baseline used for comparative analysis.

3.1. Energy Received

The amount of energy received at the distribution interface is a function of the energy evacuated, transmission losses and the wheeling capacity.

Energy Received



6,911 GWh ↑9 percent

Energy Billed



5,768 GWh ↑9 percent

₦ 187 billion ↑10 percent

Distribution Losses (ATC&C)



43% ↑5 percent

Revenue Collected



₦127 billion ↑5 percent

Collection Loss



32% ↑12 percent

Operational Performance



20.5% ↑10 percent

The grid currently operates at a wheeling capacity close to 5,500 MW, although the simulated wheeling capacity is estimated at 8,100 MW. However, there are also grid constraints and transmission losses that further reduce the operational wheeling capability to lower levels.

Several upgrades and expansions in the transmission and distribution network interfaces (132kV and 33 kV), including the lines and injection substations, can improve the amount of energy received.

For the period under review, the total average energy received at the Distribution Companies (DisCos)²⁵ was about 6,911 GWh (3,164 MW). This was a 9 percent increase from Q4 2019 (6,333 GWh, about 2,868 MW).

The recorded rise could have been as a result of several performance parameters related to the transmission sub-sector, including the 10 percent drop in transmission losses and 9 percent improvement in electricity transmitted to the distribution companies.

3.2. Distribution Losses

Distribution losses in the Nigerian Electricity Supply Industry (NESI) can be categorised into Technical, Commercial and Collection losses.

Technical losses are losses from the transmission and distribution of electricity through conductors, substations and transformers. Ideally, there should be no technical losses, but this is impossible.

However, it can be minimised with proper equipment sizing and selection.

Commercial Losses result from the energy that is consumed but not accounted for. This occurrence can be related to illicit activities, such as meter bypass, illegal connections, meter tampering and energy theft. An erroneous estimate (or under-billing) of the electricity consumption from unmetered customers could also be a reason for a commercial loss.

The non-payment of electricity utility bills by customers results in collection losses. This is the billed, but not collected revenue.

The ATC&C losses total the above-mentioned three. It is the difference between the amount of electricity received by a Distribution Company from the Transmission Company and the amount of electricity for which it invoices its customers plus the adjusted collection losses.

Consumer malpractices that attribute to these ATC&C losses are widespread across the eleven electricity distribution companies. Urgent measures are being taken to reduce these malpractices. In 2019, the average ATC&C losses were about 45 percent.

In essence, the distribution companies are still plagued with inadequate infrastructure, vandalism and theft of equipment, as well as the inability to accurately meter and invoice their customers and collect revenues.

²⁵ Data does not include Yola Distribution Company.

For the period under review, the ATC&C losses recorded were about 43 percent. This was a 5 percent increase from Q4 2019 (40 percent). The main reason for the increase that the upturn (5 percent) in the revenue collected during the period did not match the 9 percent increments in both the energy received and energy billed.

To ensure sustainable electricity utility, the reduction of overall losses within the electricity distribution system is imperative. For this reason, a Performance Agreement was implemented between successful DisCo bidders and BPE. There was also an exigency for DisCos to formulate strategies to reduce losses and improve billing efficiency²⁷, as well as revenue collection.

3.2.1. Technical and Commercial Losses

Energy theft accounts for a major part of the Aggregate Technical and Commercial (ATC) losses. The annual global losses from energy theft are about \$89.3 billion; \$58.7 billion of these losses come from emerging

For the period under review, the recorded ATC losses during electricity distribution were about 16.5 percent.

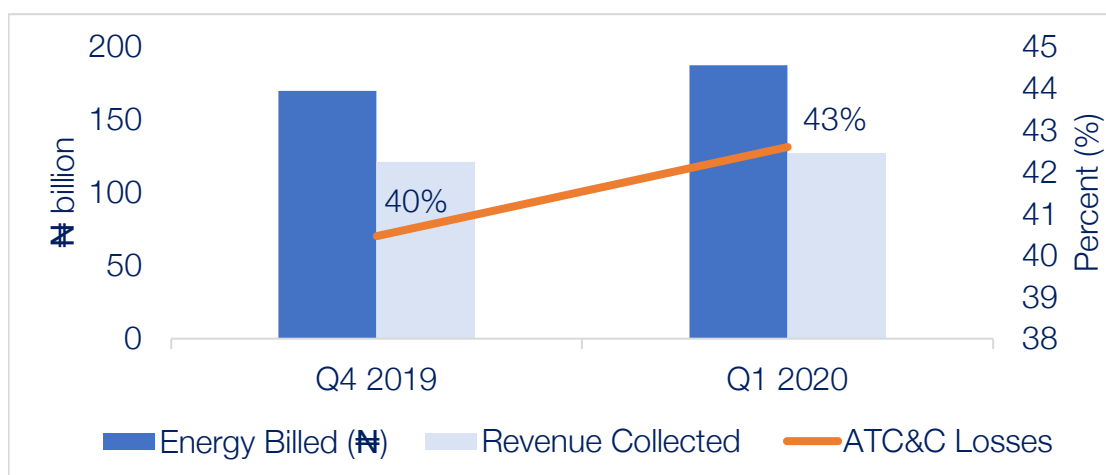


Figure 5: Energy Billed (Naira), Revenue Collected and ATC&C Losses in Q4 2019 and Q1 2020. The quarterly average was recorded for the period under review.

markets in developing countries²⁶. Many of these countries are also facing high rates of electricity demand growth, straining infrastructure, and unreliable grids. In the Nigerian Electricity Market, energy theft has led to poor collection efficiency for the DisCos, low remittance up the value-chain, and high billings to unmetered customers due to stolen and unaccounted energy.

This was a slight 1 percent reduction from Q4 2019 (16.6 percent). The logical reason for the reduction was that, in comparison to Q4, more electricity was received by the DisCos and marginally more electricity was invoiced to customers.

²⁶ Northeast Group, LLC, "Emerging Markets Smart Grid: Outlook 2015," Northeast Group LLC, Washington, 2014.

²⁷ The proportion of the energy received that is billed to the end-user.

Consequently, the total energy billed²⁸ from the Distribution Companies (DisCos) was about 5,768 GWh. This was a 9 percent rise from Q4 2019 (5,279 GWh).

3.2.2. Collection Losses

Collection losses account for a major part of the ATC&C losses. This is mainly because of the huge metering gap, which is currently over five million. Other malpractices, such as estimated billing and unwillingness to pay electricity bills also contribute to these losses.

Here is some context. As of September 30 2019, the total number of registered active electricity customers was about 9,674,729. Of this number, only 3,895,497 (about 40.3 percent) registered customers have been metered. This means that about 59.7 percent of registered customers are still on estimated billing.

More recently, there was also a huge 350 percent rise in import duty (from 10% percent to 45%) on meters. Bear in mind that the price for meters remains capped at ₦67,000 and ₦36,000 for 3-phase meters and single-phase meters respectively. As a result, the MAPs are now unable to recover their costs due to the recent hike.

The low production capacity of local meter manufacturers has further compounded the current situation because most of the manufacturers are also participating mainly as MAPs. It will also be difficult for the MAPs to unlock and access future

finances since the current model is no longer viable.

As it stands, financing for local meter manufacturing, while also reviewing the local content requirement (currently at 30%) could provide viable solutions to this problem.

Fittingly, the DisCos will need to close the metering gap by providing meters to registered consumers that are under the weight of estimated billing. This is also logical, as consumers will now pay for only the electricity they consume.

Concerning estimated billing, the general perception is that the situation translates to several outcomes. These outcomes include consumer complaints about exorbitant bills; avenues for illegal activities from DisCos' marketing staff to defraud and extort consumers; consumer apathy in paying for electricity; and hostility, assault and physical harm on DisCo staffs. Ultimately, there is a lack of transparency and accountability between the DisCos and consumers.

For resolution, consumer enumeration exercises can ensure that all existing and potential customers are registered, identified and categorised. Their details should be taken, and energy requirements determined. This exercise will allow for effective planning and future infrastructural development. It will also enable the Meter Asset Providers (MAPs) to effectively roll-out pre-paid meters to registered customers.

²⁸ The energy billed amounted to about ₦ 187 billion - a 10 percent upturn from Q4 2019 (₦ 169 billion).

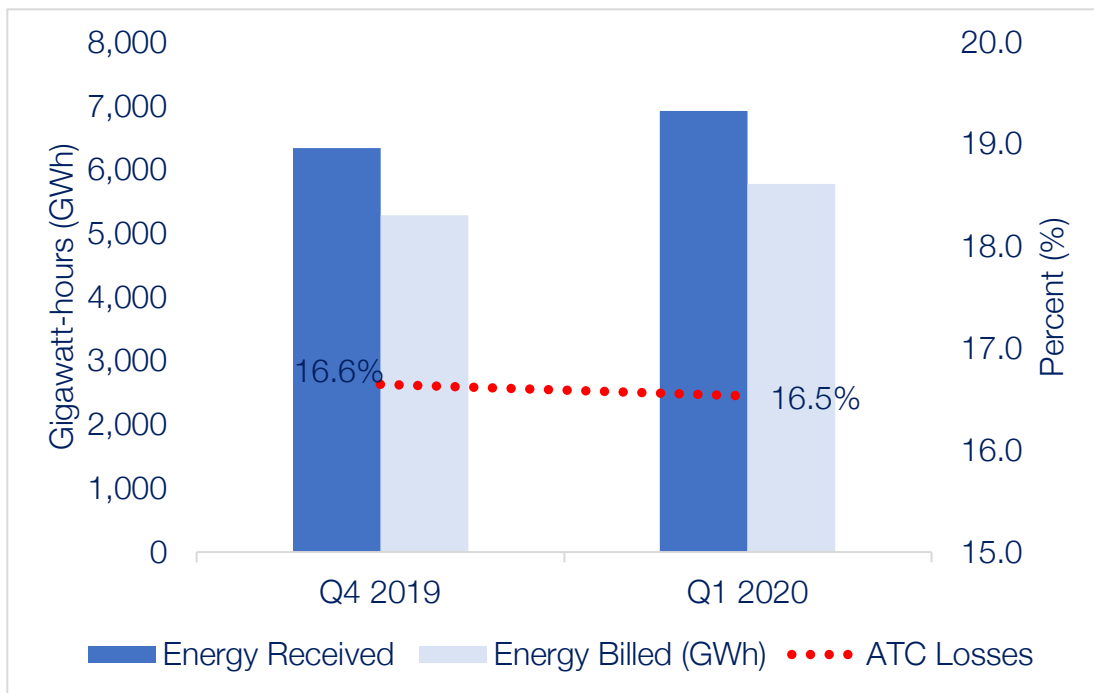


Figure 6: Energy Received (GWh), Energy Billed (GWh), and ATC Losses in Q4 2019 and Q1 2020. The quarterly average was recorded for the period under review.

Consumers also need to be better sensitised and protected. This can improve on their willingness to pay for electricity consumed.

For the period under review, the collected revenue recorded was ₦127 billion. This was a 5 percent increase from Q4 2019 (₦121 billion). Since the upturn in the revenue collected did not match the increments in the electricity received and billed, it resulted in a collection loss of 32 percent – a 12 percent rise from Q4 2019 (29 percent).

3.3. Operational Performance


The operational performance is recorded as a percentage of the installed generation capacity (about 12,910 MW).

For the period under review, the average operational performance of the distribution sub-sector was 20.5 percent. This was a 10 percent improvement from Q4 2020 (18.5 percent).

It also means that only about 20 percent of the total installed capacity gets distributed to the end-user for consumption.

Table 3: Distribution Performance Data in Q4 2019 and Q1 2020. The quarterly average was recorded for the period under review.

Period	Q4 2019	Q1 2020
Energy Received (GWh)	6,333	6,911
ATC Losses (percent)	16.6	16.5
Energy Billed (GWh)	5,279	5,768
Energy Billed (₦ billion)	169	187
Revenue Collected (₦ billion)	121	127
Collection Loss (percent)	29	32
ATC&C Losses (percent)	40	43

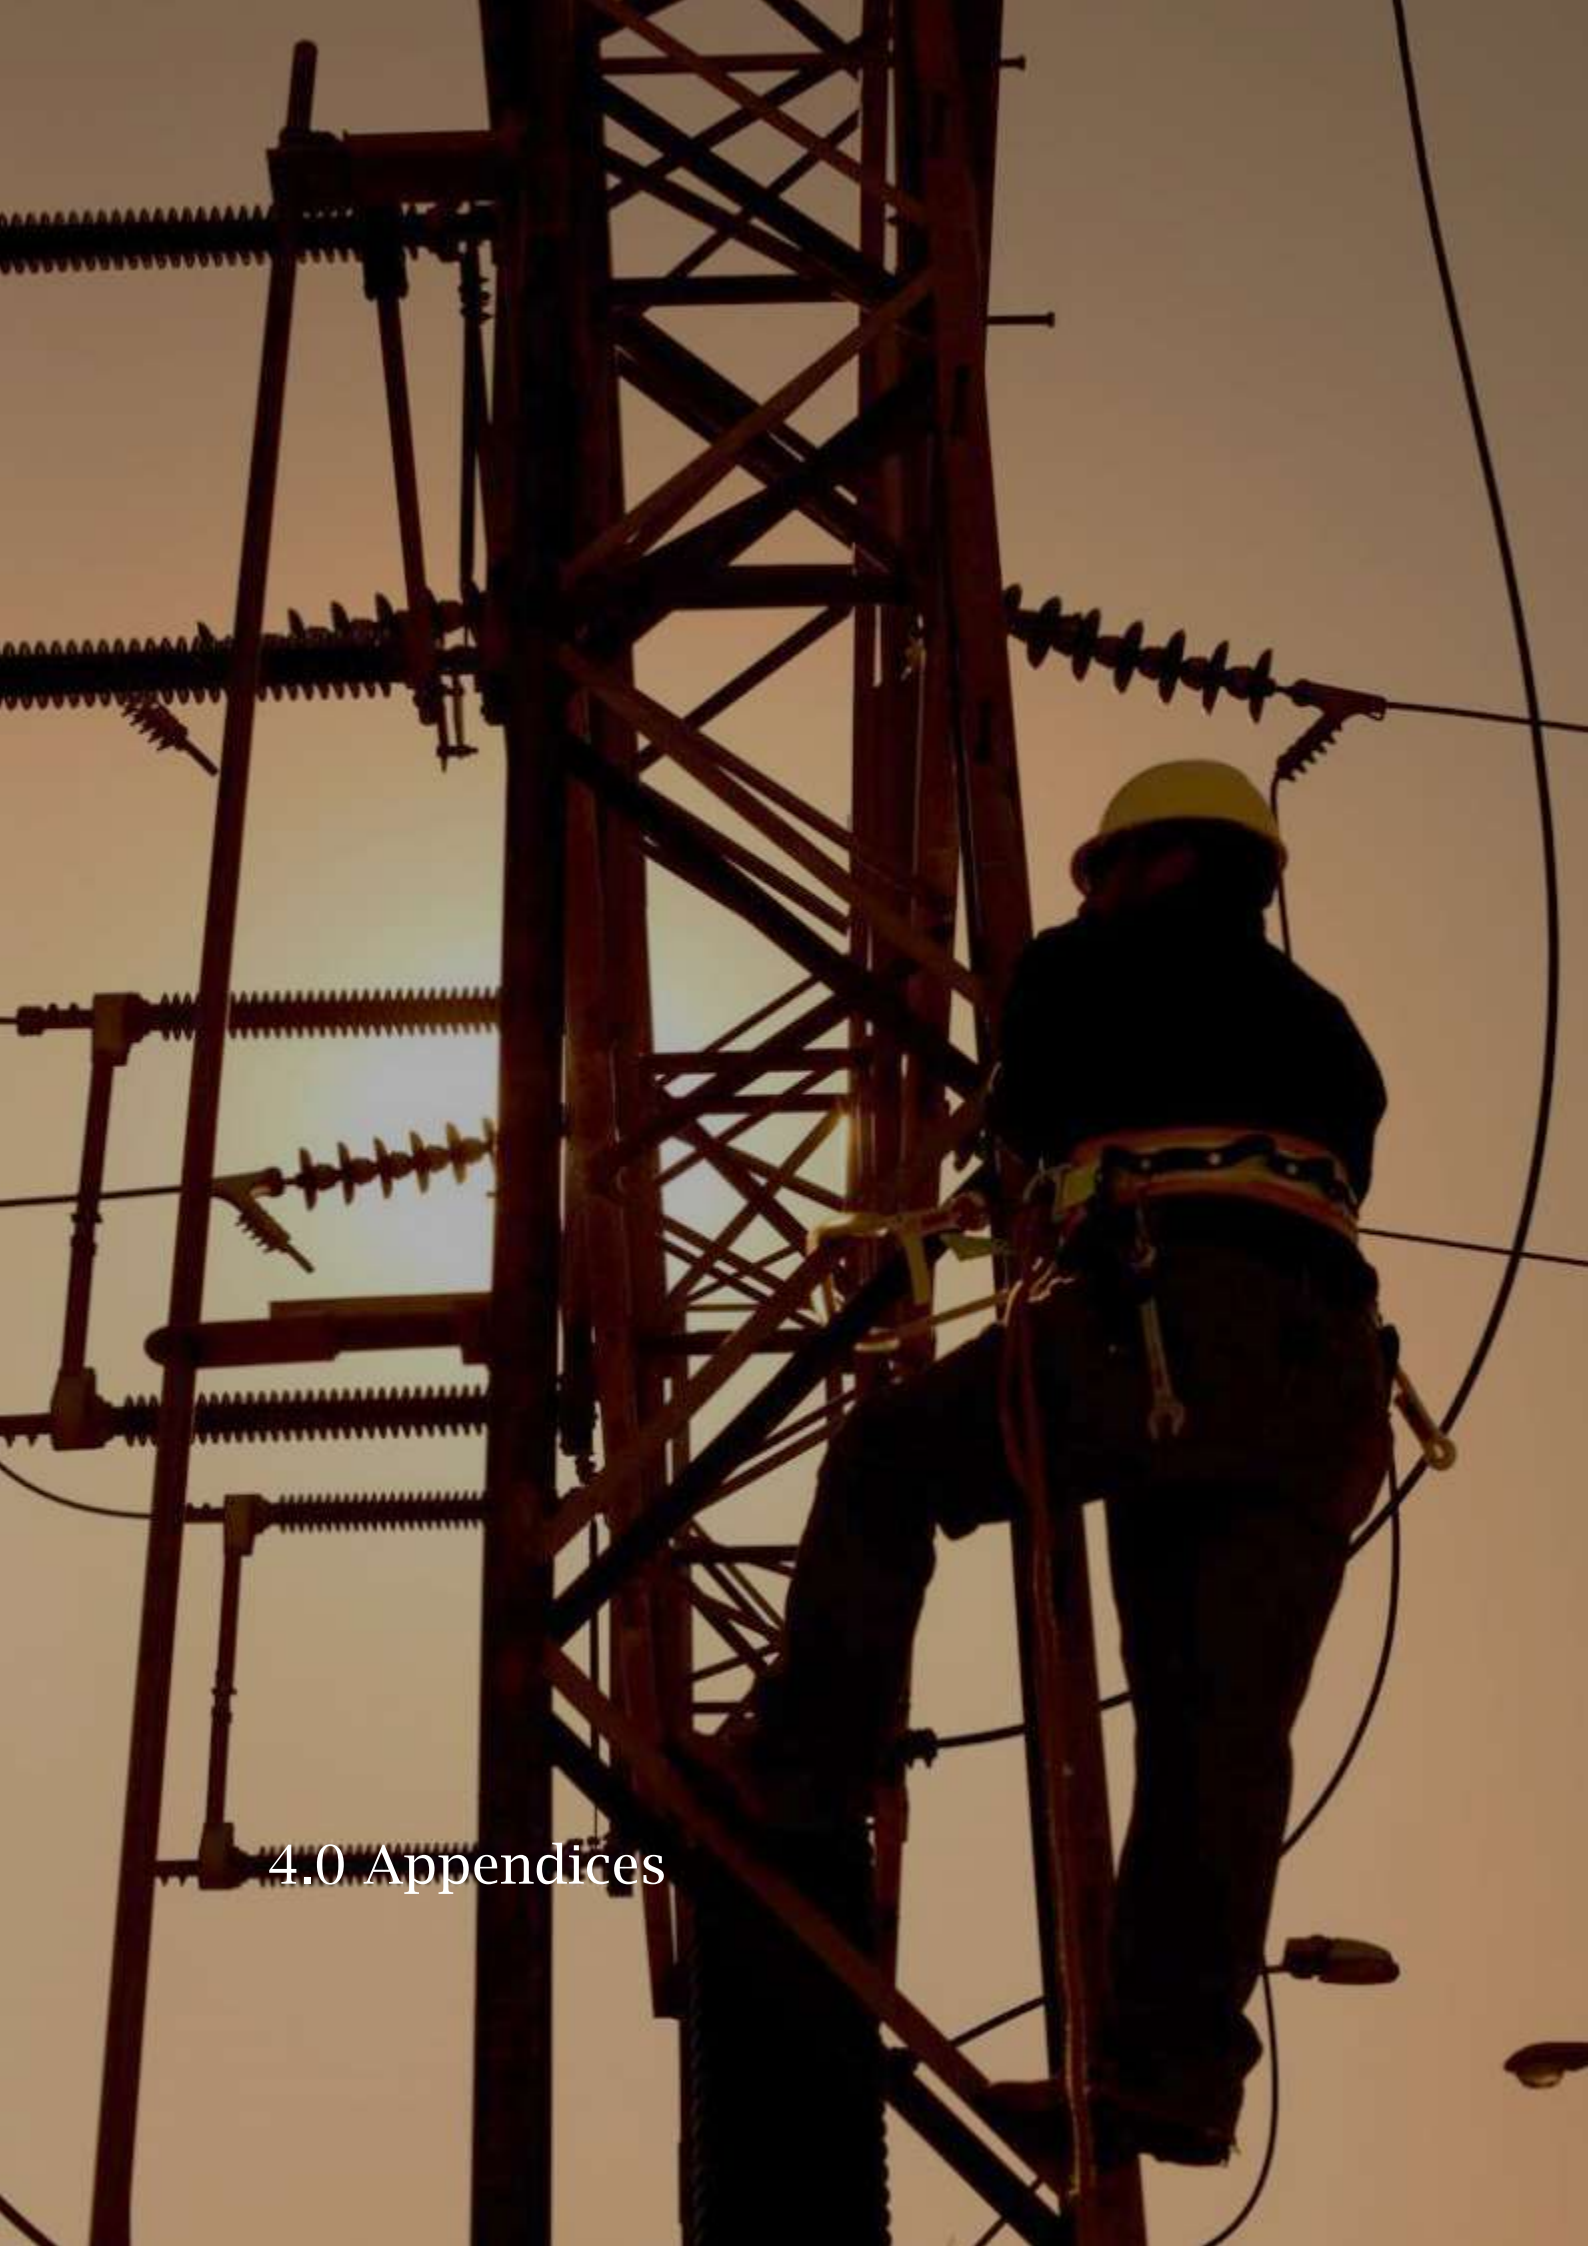

4.0 Appendices

4.1. Generation Data²⁹

Oct-19	Average Hourly Energy Evacuated in a Day (MWh/h)	Daily Constraints - Total (MWh/h)	Daily Gas Constraints (MWh/h)	Daily Grid Constraints (MWh/h)	Daily Water Constraints (MWh/h)	Daily Gas Supplied, Gas-to-Power (MMSCFD)
1	3,369.27	4,324.30	2,157.50	2,054.30	0.00	595.18
2	3,216.42	4,567.70	2,031.00	2,424.20	0.00	516.42
3	3,279.56	4,798.00	2,238.00	2,447.50	0.00	529.99
4	3,405.88	4,553.40	2,073.00	2,480.40	0.00	538.27
5	3,445.93	4,696.40	1,878.00	2,818.40	0.00	535.88
6	3,237.77	4,798.00	1,878.00	2,920.00	0.00	488.40
7	3,485.19	4,066.30	1,626.00	2,440.30	0.00	524.02
8	3,436.16	4,383.80	1,846.00	2,425.30	0.00	548.29
9	3,630.52	3,947.40	1,846.00	2,101.40	0.00	554.64
10	3,742.13	3,863.90	1,635.50	2,228.40	0.00	589.24
11	3,706.52	5,274.90	1,762.00	3,512.90	0.00	581.70
12	3,225.72	4,444.20	1,862.00	2,582.20	0.00	534.74
13	3,479.74	4,503.30	1,726.00	2,777.30	0.00	546.16
14	3,608.68	4,843.20	1,635.50	2,982.70	0.00	584.47
15	3,400.85	4,194.40	1,677.50	2,401.90	0.00	522.63
16	3,499.72	4,058.30	1,551.00	2,352.30	0.00	542.10
17	3,587.12	4,847.90	1,674.00	3,133.90	0.00	580.44
18	3,365.42	4,753.10	1,547.50	3,205.60	0.00	550.45
19	3,348.65	4,890.00	1,631.50	3,258.50	0.00	511.27
20	3,103.85	4,351.00	1,379.50	2,751.50	0.00	469.09
21	3,487.55	4,462.50	2,054.00	2,408.50	0.00	589.98
22	3,779.56	4,708.50	2,180.50	2,528.00	0.00	615.81
23	3,527.95	4,517.50	1,889.00	2,588.60	0.00	571.99
24	3,563.10	4,087.00	2,238.50	1,810.00	0.00	585.94
25	3,634.56	4,420.40	2,115.50	2,266.30	0.00	625.09
26	3,505.39	4,062.40	1,989.00	1,699.10	0.00	517.62
27	3,351.76	4,751.90	2,655.00	1,984.40	0.00	542.55
28	3,271.23	3,979.00	1,865.50	2,113.50	0.00	545.20
29	3,557.69	3,677.30	1,352.00	2,325.30	0.00	598.24
30	3,519.70	3,805.60	1,530.50	2,275.10	0.00	457.27
31	3,621.14	3,643.10	1,522.00	2,121.10	0.00	638.68
TOTAL	107,394.73	136,274.70	57,047.00	77,418.90	0.00	17,131.75
AVERAGE	3,464.35	4,395.96	1,840.23	2,497.38	0.00	552.64

²⁹ Source: The Advisory Power Team, Office of the Vice President

Nov-19	Average Hourly Energy Evacuated in a Day (MWh/h)	Daily Constraints - Total (MWh/h)	Daily Gas Constraints (MWh/h)	Daily Grid Constraints (MWh/h)	Daily Water Constraints (MWh/h)	Daily Gas Supplied, Gas-to-Power (MMSCFD)
1	3,669.34	4,244.80	1,427.50	2,667.30	0.00	626.95
2	3,416.03	4,082.00	1,554.00	2,418.00	0.00	570.19
3	3,429.58	4,183.20	1,554.00	2,519.20	0.00	551.63
4	3,765.14	3,956.30	1,427.50	2,462.20	0.00	598.05
5	3,868.15	3,886.50	1,262.50	2,557.40	0.00	616.27
6	3,855.02	3,876.40	1,262.50	2,613.90	0.00	616.93
7	3,840.25	3,866.30	1,262.50	2,540.80	0.00	582.16
8	3,808.96	1,042.50	1,042.50	0.00	0.00	542.33
9	2,546.49	4,311.10	1,356.00	2,842.60	0.00	513.79
10	3,610.05	4,559.00	1,356.00	3,093.00	0.00	528.24
11	3,856.30	3,396.70	1,482.50	1,914.20	0.00	617.69
12	3,878.58	3,334.00	1,382.50	1,951.50	0.00	643.92
13	3,722.76	3,454.60	1,256.00	2,086.10	0.00	612.17
14	3,533.74	3,446.00	1,256.00	2,190.00	0.00	583.85
15	3,882.84	4,029.40	1,547.50	2,481.90	0.00	643.92
16	3,714.44	3,905.50	2,232.50	1,673.00	0.00	642.40
17	3,819.71	3,709.50	2,067.50	1,642.00	0.00	693.22
18	4,152.33	3,261.00	2,362.00	899.00	0.00	754.62
19	4,214.14	3,454.70	2,446.50	1,008.20	0.00	750.32
20	4,214.14	3,454.70	2,446.50	1,008.20	0.00	711.45
21	3,870.50	4,100.50	2,521.50	1,469.00	0.00	627.34
22	3,775.27	3,213.70	2,113.50	1,100.20	0.00	662.22
23	4,034.94	3,469.60	2,185.00	1,220.60	0.00	737.69
24	3,874.68	3,605.20	2,146.50	1,293.70	0.00	677.64
25	3,965.06	3,075.80	2,146.50	869.30	0.00	723.40
26	4,166.93	3,775.60	2,538.00	1,177.60	0.00	747.55
27	3,843.58	3,504.50	2,580.00	864.50	0.00	702.64
28	4,025.54	3,632.60	2,580.00	733.50	0.00	739.26
29	3,993.35	3,835.30	2,833.00	682.10	0.00	738.04
30	3,913.58	3,646.50	2,748.50	691.00	0.00	739.30
TOTAL	114,261.42	109,313.50	56,377.00	50,670.00	0.00	19,495.18
AVERAGE	3,808.71	3,643.78	1,879.23	1,689.00	0.00	649.84

Dec-19	Average Hourly Energy Evacuated in a Day (MWh/h)	Daily Constraints - Total (MWh/h)	Daily Gas Constraints (MWh/h)	Daily Grid Constraints (MWh/h)	Daily Water Constraints (MWh/h)	Daily Gas Supplied, Gas-to-Power (MMSCFD)
1	3,815.59	3,530.50	3,295.50	65.00	0.00	-
2	3,717.67	3,687.50	3,517.50	0.00	0.00	-
3	3,751.62	3,573.40	3,475.50	0.00	0.00	-
4	3,837.95	3,470.30	3,375.50	0.00	0.00	-
5	3,793.91	3,612.60	3,517.40	0.00	0.00	-
6	3,880.81	4,156.70	3,352.50	599.00	0.00	-
7	3,799.33	3,924.70	3,352.50	367.00	0.00	-
8	3,848.61	3,669.10	3,046.00	421.00	0.00	-
9	4,007.80	3,546.50	3,122.50	254.00	0.00	-
10	4,139.80	3,482.50	2,869.50	443.00	0.00	-
11	2,146.11	3,546.50	3,122.50	254.00	0.00	-
12	753.12	3,366.50	2,885.50	311.00	0.00	-
13	3,091.60	3,556.00	3,007.50	378.50	0.00	-
14	3,939.93	3,758.70	2,800.50	788.20	0.00	-
15	3,878.35	3,778.30	2,800.50	917.80	0.00	-
16	3,843.81	3,531.50	2,965.50	506.00	0.00	-
17	4,037.39	3,417.50	2,965.50	392.00	0.00	-
18	4,037.00	3,417.50	2,965.50	392.00	0.00	-
19	4,120.16	3,353.30	2,670.50	622.80	0.00	-
20	4,257.51	3,892.90	2,870.00	930.30	0.00	-
21	4,087.18	3,896.80	2,705.00	859.30	0.00	-
22	3,967.87	4,007.30	2,830.00	1,117.30	0.00	-
23	3,866.96	3,958.00	2,636.50	1,101.50	0.00	-
24	4,096.69	3,951.50	2,536.50	1,355.00	0.00	-
25	4,216.60	3,902.20	2,410.00	1,432.20	0.00	-
26	4,123.34	3,861.80	2,343.00	1,458.80	0.00	-
27	4,046.98	4,029.50	2,343.00	1,578.00	0.00	-
28	3,935.83	4,162.20	2,523.00	1,540.80	0.00	-
29	3,780.18	4,087.00	2,523.00	1,284.00	0.00	-
30	3,936.49	3,954.30	2,318.00	1,425.80	0.00	-
31	3,897.84	3,926.20	2,318.00	1,508.40	0.00	-
TOTAL	116,654.03	116,009.30	89,463.90	22,302.70	0.00	-
AVERAGE	3,763.03	3,742.24	2,885.93	719.44	0.00	-

Jan-20	Average Hourly Energy Evacuated in a Day (MWh/h)	Daily Constraints - Total (MWh/h)	Daily Gas Constraints (MWh/h)	Daily Grid Constraints (MWh/h)	Daily Water Constraints (MWh/h)	Daily Gas Supplied, Gas-to-Power (MMSCFD)
1	3,993.15	4,160.10	2,026.50	2,073.60	0.00	-
2	3,607.50	4,503.60	2,026.50	2,417.10	0.00	-
3	3,444.10	4,273.70	2,026.50	2,187.20	0.00	-
4	3,475.39	4,232.00	1,900.00	2,196.00	0.00	-
5	3,552.09	3,583.30	1,900.00	1,623.30	0.00	-
6	3,810.88	3,613.90	1,900.00	1,653.90	0.00	-
7	3,906.68	3,569.60	2,042.00	1,467.60	0.00	-
8	3,997.49	3,542.10	2,410.00	1,072.10	0.00	-
9	4,032.65	3,568.10	2,547.50	960.60	0.00	-
10	4,002.81	3,880.50	2,716.00	992.00	0.00	-
11	3,839.77	3,949.90	2,758.00	952.00	150.00	-
12	3,735.67	3,799.00	2,716.00	873.00	150.00	-
13	3,909.96	3,419.80	2,632.00	544.00	150.00	-
14	4,166.11	3,603.60	2,632.00	728.00	150.00	-
15	4,120.23	3,877.90	2,889.00	749.00	150.00	-
16	2,372.51	3,087.00	2,669.00	208.00	150.00	-
17	3,536.51	4,336.50	3,708.50	418.00	150.00	-
18	3,871.07	4,131.50	2,935.50	836.00	300.00	-
19	3,730.50	4,016.00	3,054.00	752.00	150.00	-
20	3,813.95	3,877.40	3,261.00	372.00	150.00	-
21	3,924.69	3,457.90	3,032.50	181.00	150.00	-
22	3,974.77	3,290.10	3,082.50	110.00	0.00	-
23	4,118.01	3,888.10	3,032.50	523.00	235.00	-
24	3,859.27	3,831.00	3,159.00	612.00	0.00	-
25	3,708.10	3,896.20	3,195.50	367.00	245.00	-
26	3,880.85	3,513.70	3,030.50	245.00	150.00	-
27	3,942.12	3,555.60	3,205.50	0.00	150.00	-
28	3,959.88	3,567.80	3,224.00	0.00	150.00	-
29	4,094.69	3,716.60	3,044.00	229.10	245.00	-
30	3,958.09	3,682.90	3,044.00	198.00	245.00	-
31	4,106.18	4,091.30	3,374.00	276.40	245.00	-
TOTAL	118,445.67	117,516.70	85,174.00	25,816.90	3,465.00	-
AVERAGE	3,820.83	3,790.86	2,747.55	832.80	111.77	-

Feb-20	Average Hourly Energy Evacuated in a Day (MWh/h)	Daily Constraints - Total (MWh/h)	Daily Gas Constraints (MWh/h)	Daily Grid Constraints (MWh/h)	Daily Water Constraints (MWh/h)	Daily Gas Supplied, Gas-to-Power (MMSCFD)
1	4,030.80	4,380.50	3,479.00	460.90	245.00	-
2	3,937.12	3,534.60	2,959.00	135.00	245.00	-
3	4,111.27	3,349.80	2,754.50	155.00	245.00	-
4	4,206.13	3,058.10	2,712.50	0.00	150.00	-
5	4,145.03	3,219.10	2,712.50	178.00	150.00	-
6	4,092.15	3,691.80	3,106.00	298.00	150.00	-
7	4,039.68	3,993.70	3,232.50	474.50	150.00	-
8	3,871.67	3,940.10	3,067.50	491.50	245.00	-
9	3,929.42	4,069.30	3,067.50	621.50	245.00	-
10	3,907.70	4,476.40	3,067.50	1,028.50	245.00	-
11	3,994.31	4,064.20	3,067.50	711.20	150.00	-
12	4,033.30	4,171.40	3,025.50	885.90	150.00	-
13	3,996.83	4,181.40	3,019.00	852.80	150.00	-
14	4,108.34	4,081.80	3,314.00	579.20	0.00	-
15	4,200.63	4,174.70	3,534.00	470.80	0.00	-
16	4,067.44	4,041.10	3,534.00	236.00	150.00	-
17	4,195.69	3,578.40	3,154.00	141.10	150.00	-
18	4,235.82	3,963.30	3,221.00	632.30	0.00	-
19	4,139.93	3,967.90	3,347.50	400.40	0.00	-
20	3,888.88	4,525.90	3,970.50	335.40	0.00	-
21	3,932.50	4,242.00	3,308.50	711.00	0.00	-
22	4,091.85	3,791.21	3,060.50	508.21	0.00	-
23	4,096.09	3,788.90	3,060.50	505.90	0.00	-
24	4,091.35	3,465.00	3,060.50	182.00	0.00	-
25	4,450.83	3,555.00	2,967.50	365.00	0.00	-
26	4,595.26	3,510.30	2,914.00	486.30	0.00	-
27	4,628.53	4,811.30	3,169.00	1,532.30	0.00	-
28	4,011.72	4,522.00	3,330.50	1,081.50	0.00	-
29	4,268.89	4,358.40	3,432.00	816.40	0.00	-
TOTAL	119,299.16	114,507.61	91,648.50	15,276.61	2,820.00	-
AVERAGE	4,113.76	3,948.54	3,160.29	526.78	97.24	-

Mar-20	Average Hourly Energy Evacuated in a Day (MWh/h)	Daily Constraints - Total (MWh/h)	Daily Gas Constraints (MWh/h)	Daily Grid Constraints (MWh/h)	Daily Water Constraints (MWh/h)	Daily Gas Supplied, Gas-to-Power (MMSCFD)
1	4,014.01	4,611.50	4,516.50	95.00	0.00	-
2	3,705.92	4,595.00	4,200.00	395.00	0.00	-
3	3,554.04	4,104.80	3,630.00	214.80	0.00	-
4	3,660.90	3,890.00	3,630.00	0.00	0.00	-
5	3,933.79	4,014.00	3,655.00	0.00	0.00	-
6	3,887.14	4,491.90	3,895.00	224.40	0.00	-
7	3,694.08	4,750.40	4,466.00	0.00	0.00	-
8	3,634.17	4,468.00	4,208.00	0.00	0.00	-
9	3,820.97	4,593.00	4,363.00	0.00	0.00	-
10	3,809.70	4,731.50	4,576.50	0.00	0.00	-
11	3,738.36	4,554.50	4,414.50	0.00	0.00	-
12	3,555.21	4,356.00	4,246.00	0.00	0.00	-
13	3,731.61	4,301.30	3,918.00	273.30	0.00	-
14	3,776.13	3,778.00	3,668.00	0.00	0.00	-
15	4,186.78	3,946.00	3,641.00	195.00	0.00	-
16	4,361.45	3,844.00	3,476.00	258.00	0.00	-
17	4,375.92	4,348.30	3,518.00	720.30	0.00	-
18	4,149.41	4,281.30	3,568.00	603.30	0.00	-
19	3,995.24	4,182.20	3,668.00	404.20	0.00	-
20	4,128.91	4,103.70	3,643.00	361.70	0.00	-
21	4,068.19	3,919.00	3,568.00	351.00	0.00	-
22	4,126.74	4,521.90	4,024.50	497.40	0.00	-
23	3,988.22	5,480.30	4,024.50	1,455.80	0.00	-
24	3,345.42	5,128.20	3,934.50	1,193.70	0.00	-
25	3,882.99	4,634.10	3,934.50	699.60	0.00	-
26	3,973.82	4,480.10	4,099.50	380.60	0.00	-
27	3,906.40	4,355.60	4,144.50	211.10	0.00	-
28	3,887.10	4,281.80	4,156.50	125.30	0.00	-
29	3,983.75	4,236.50	4,056.50	180.00	0.00	-
30	4,257.23	4,295.00	3,760.00	535.00	0.00	-
31	4,152.90	5,295.90	4,070.00	1,225.90	0.00	-
TOTAL	121,286.50	136,573.80	122,673.50	10,600.40	0.00	-
AVERAGE	3,912.47	4,405.61	3,957.21	341.95	0.00	-

4.2. Distribution Data³⁰

Period	Q4 2019	Q1 2020	Q4 2019	Q1 2020
DisCos	Energy Received (GWh)	Energy Received (GWh)	Energy Received (MW)	Energy Received (MW)
AEDC	906.00	931.00	410.33	426.28
BEDC	515.37	615.44	233.41	281.79
EKEDC	822.69	887.85	372.60	406.52
EEDC	541.00	591.00	245.02	270.60
IBEDC	876.65	988.65	397.04	452.68
IE	1,059.96	1,175.64	480.06	538.30
JEDC	308.20	327.68	139.58	150.04
KED	406.00	441.00	183.88	201.92
KEDCO	406.75	425.95	184.22	195.03
PHED	490.58	526.43	222.18	241.04
TOTAL	6,333.21	6,910.63	2,868.30	3,164.21
AVERAGE	633.32	691.06	286.83	316.42

³⁰ Source: Association of Nigerian Electricity Distributors (ANED). Data does not include Yola Distribution Company.

Acknowledgement

We acknowledge the contributions of our sponsors in the design, concept and production of this publication.





POWER
Nextier
Advisory . Investment . Services

5 Kikuyu Close, Off Nairobi Crescent, Wuse 2, Abuja, Nigeria.

@NextierPower info@nextierpower.com

Nextier Power is a consulting firm that provides policy advisory, investment advisory, and support services to the electricity supply industry. Please send your questions and comments to info@nextierpower.com. You can also visit www.nigeriaelectricityhub.com for more information on Nigeria's power sector.